



G:\ENGINEERING&OPERATION\ENGINEER DRAWINGS\PowerDwgs\WorkOrder\Construction Standard\Material & Inst Criteria UG Elect System\1L620.1.dwg

REV	DESCRIPTION	BY	DATE
1	CUSTOMER PROVIDES CABLES	T.N.	6/23/21
2	CORRECT TITLE	DB	5/14/20

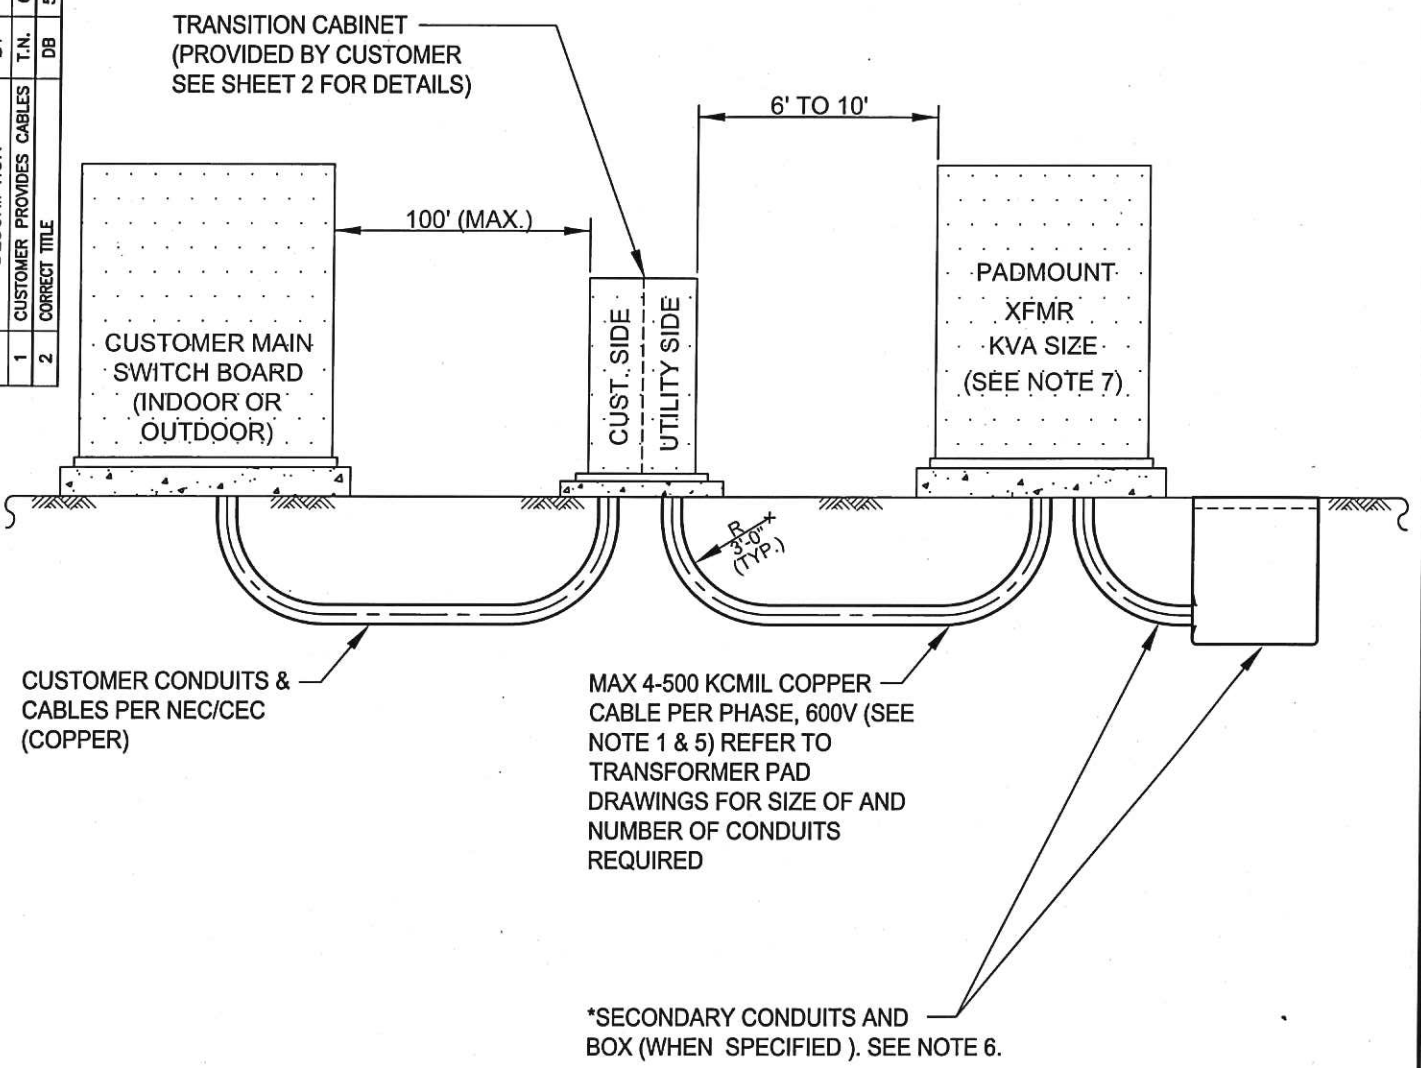

NOTES:

1. CUSTOMER SHALL FURNISH, INSTALL THE SERVICE LATERAL CONDUCTORS BETWEEN THE TRANSITION CABINET AND TRANSFORMER SECONDARY TERMINALS. AMP WILL TERMINATE, CABLES AT TRANSFORMER SECONDARY TERMINALS.
2. CUSTOMER SHALL INSTALL CABLES FROM THE TRANSITION CABINET TO THE MAIN SWITCHBOARD.
3. THE DESIGNATED SERVICE POINT SHALL BE THE CUSTOMER OWNED AND SUPPLIED TRANSITION CABINET.
4. THE TRANSITION CABINET SHALL BE FABRICATED PER SHT. 2 OR APPROVED EQUIVALENT.
5. AMP WILL PROVIDE LUGS ON THE TRANSFORMER SECONDARY TERMINALS. CUSTOMER SHALL PROVIDE/INSTALL LUGS AND TERMINATE CABLES AT SWITCHGEAR AND TRANSITION CABINET.
6. AMP MAY REQUIRE ADDITIONAL SECONDARY CONDUIT AND BOX FOR SECONDARY DISTRIBUTION USE. BOX SHALL BE SEALABLE.
7. CONSULT AMP ENGINEERING

 ALAMEDA MUNICIPAL POWER <small>A Department of the City of Alameda 2000 GRAND STREET, P.O. BOX H ALAMEDA, CALIFORNIA 94501</small>	TITLE :			
	SECONDARY SERVICE TRANSITION CABINET SERVICE SIZE LARGER THAN 1600A			
	DRAWN :	L.Y.A./D.B.	DATE: JUNE 25, 2021	DWG. NO.:
REVIEWED:	<i>[Signature]</i>		1-L-620	2
APPROVED:	<i>[Signature]</i>		SCALE: NTS	SHT 1 OF 2