

METER WORKING SPACE

Working space in front of the meter permits access to the metering installation and provides a safe working environment for personnel. A working space entirely on the property of the customer is required in front of all meters.

- a. The working space is to be kept clear and unobstructed at all times. Landscaping, structures or stored material shall not intrude into the working space.
- b. The height of the clear working space shall be 75 inches (190.5cm) minimum from the standing surface.
- c. The width of the clear working space shall be 30 inches (76.2cm) minimum on one-meter installation and shall extend the additional width necessary for access to the total number of metering panels. Centerline of any meter shall not be less than 10 inches (25.4cm) from adjacent side wall or other protruding obstruction.
- d.. The depth of the clear working space shall be 36 inches (91.4cm) minimum services rated 150V or less to ground. When the service is in excess of 150V to ground, the depth shall be as require applicable electrical codes ar as dictated by the physical design and arrangement of the metering cubicles.

REV	DESCRIPTION	BY	DATE
1	CHANGED 78" TO 75" MAX. AND 66" TO 48" MIN. AND 30" WIDE TO 36"	jmu	5/3/02
2	REV. DIMENSIONS & NOTES	C.B.	8/20/03
3	ADD NOTE 4	C.B.	10/26/05
4	CHANGE CO. NAME	T.N.	11/20/09
5	CHANGED TO SURFACE MOUNT.	L.M.	2/4/2025

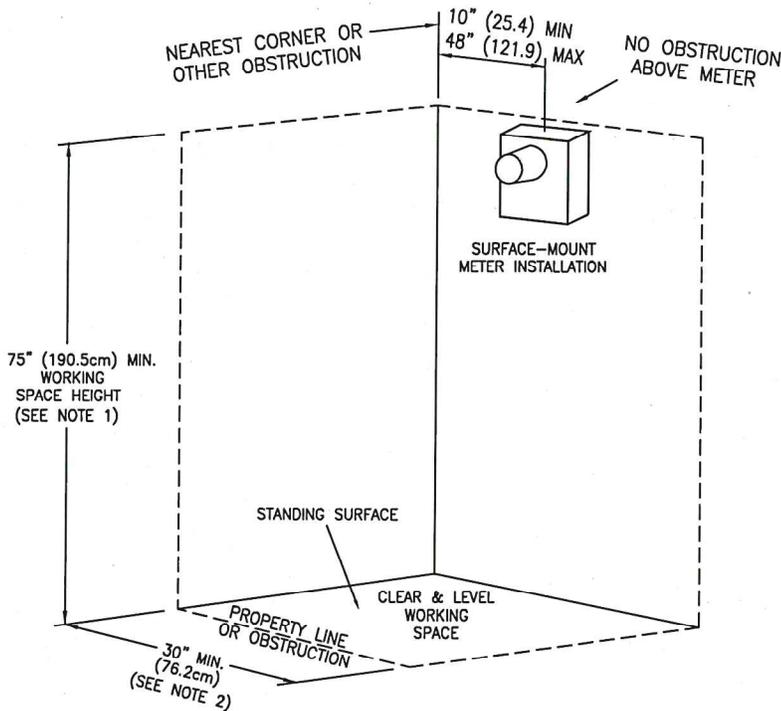


FIGURE 1
SURFACE-MOUNT METER INSTALLATION


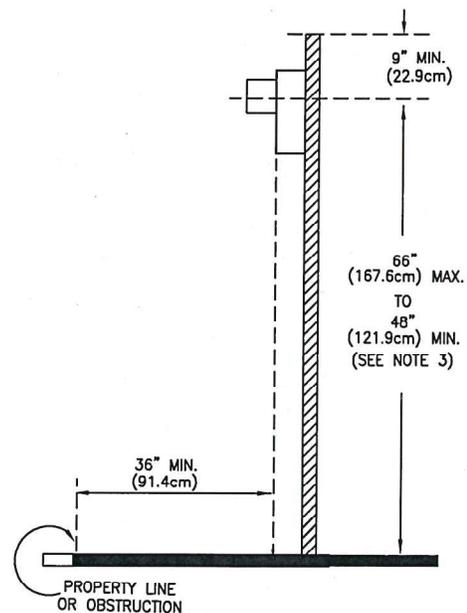


FIGURE 2
SURFACE-MOUNT METER INSTALLATION

NOTES:

1. 78" (198.12cm) MINIMUM REQUIRED FOR OTHER THAN INDIVIDUAL FIELD-INSTALLED METER PANELS
2. EUSERC ALLOWS 48" (121.9cm) MINIMUM AND 75" (190.5cm) MAXIMUM METER HEIGHT FOR FREE STANDING-FACTORY ASSEMBLED STRUCTURE (e.g. SWITCHBOARD OR METER PEDESTAL).
3. METER HEIGHT SHALL BE 72" (182.9cm) MIN. TO 75" (190.5cm) MAX. WHEN INSTALLED NEAR DRIVEWAY.



TITLE :			
METER WORKING SPACE			
DRAWN :	AT	DATE: FEB. 4, 2025	DWG. NO. :
REVIEWED:	<i>[Signature]</i>		1-L-451
APPROVED:	<i>[Signature]</i>		REV. 5
SCALE : NTS			SHT 1 OF 1